


# GREATER NEW HAVEN WATER POLLUTION CONTROL AUTHORITY CONSTRUCTION DETAILS

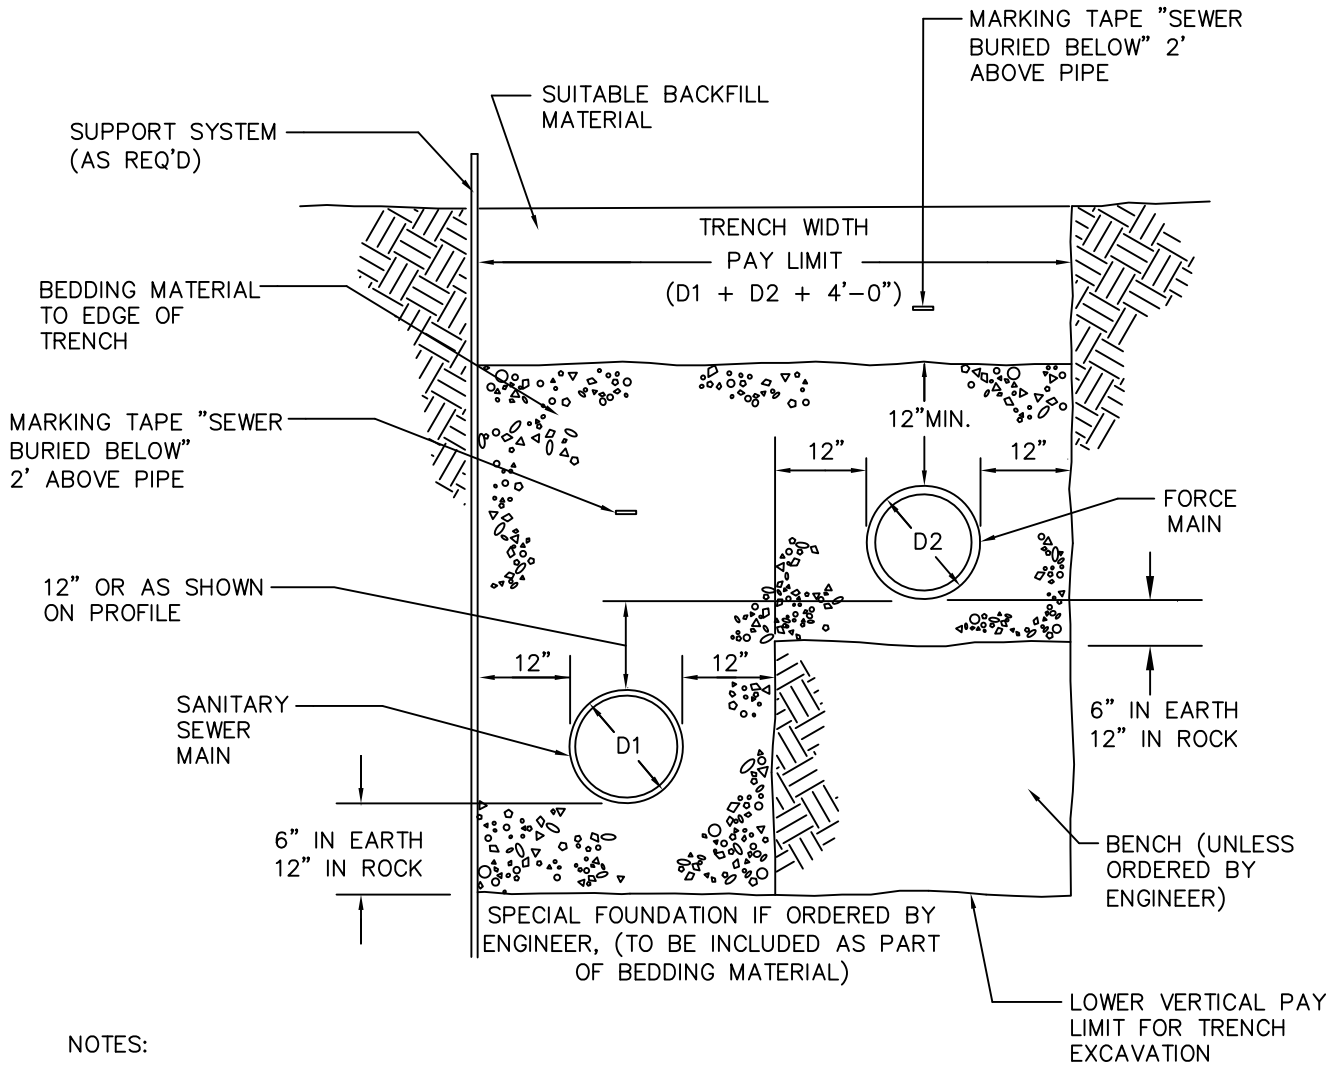

## NOTES:

1. BEDDING AND BACKFILL MATERIAL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY.

## FORCE MAIN & SANITARY SEWER

### IN SAME TRENCH

NTS

REVISIONS	
NO.	DATE
1	JUNE 2008