


GREATER NEW HAVEN WATER POLLUTION CONTROL AUTHORITY CONSTRUCTION DETAILS

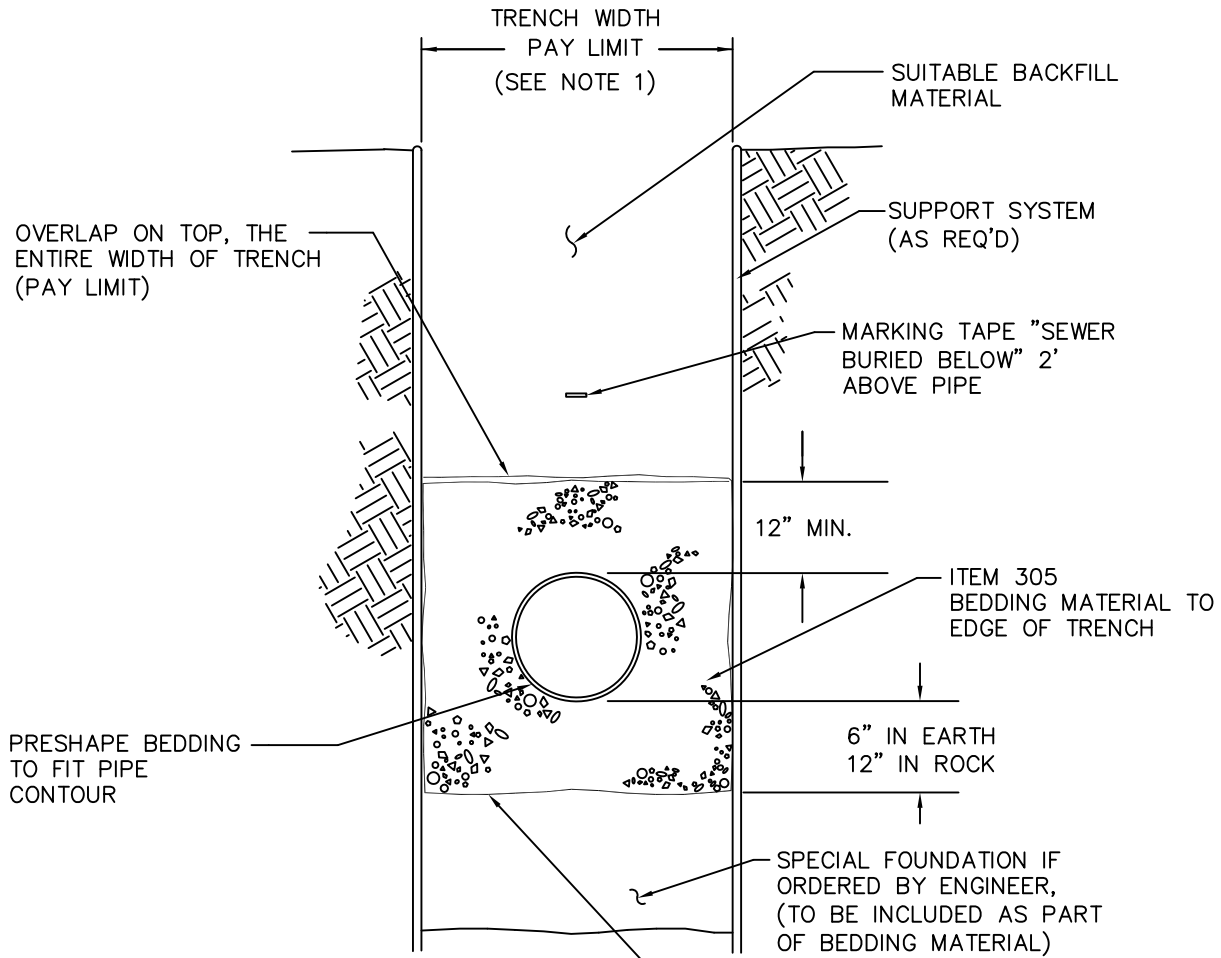

NOTES:

1. MAXIMUM PAY WIDTH FOR BEDDING MATERIAL & TRENCH EXCAVATION IS I.D. + 2'-0" FOR I.D. LESS THAN 30"; I.D. + 3'-0" FOR EQUAL TO OR GREATER THAN 30".
2. BEDDING AND BACKFILL MATERIAL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY.

WRAP SEWER MAINS/BEDDING MATERIAL IN MIRAFI 140N OR SUPAC 5NP FILTER FABRIC OR AN APPROVED EQUAL CONFORMING TO THE REQUIREMENTS OF CONN DOT FORM 816, 2004, ARTICLE M.08.01.26 AS AMENDED.

TRENCH SECTION SANITARY SEWER MAIN

NTS

REVISIONS	
NO.	DATE
1	JUNE 2008
2	SEPT. 16, 2008