


GREATER NEW HAVEN WATER POLLUTION CONTROL AUTHORITY CONSTRUCTION DETAILS

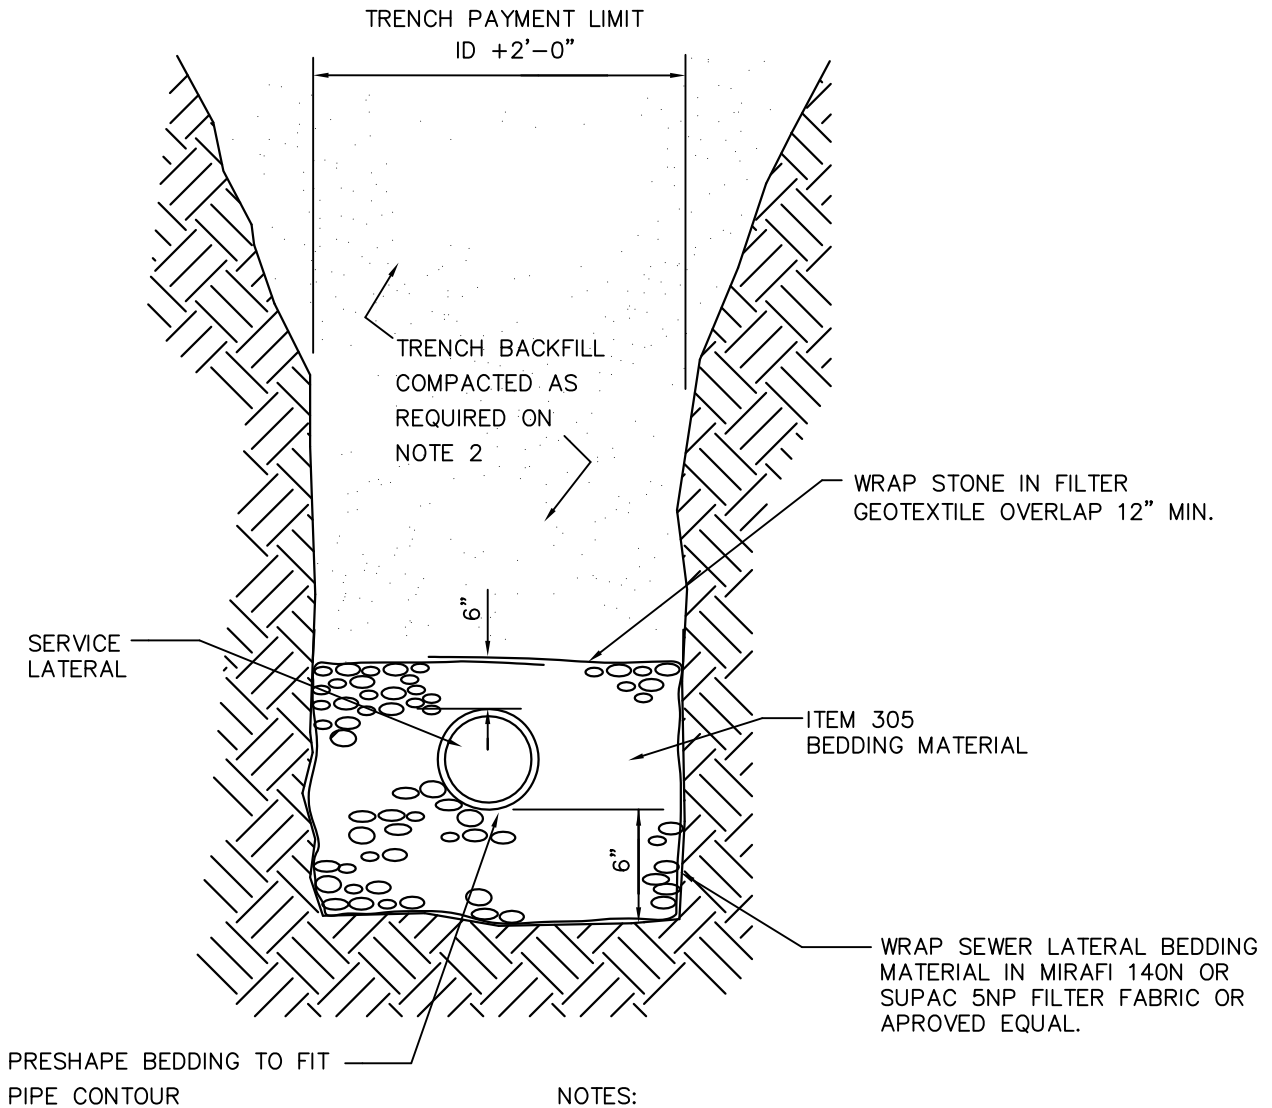

NOTES:

1. MAXIMUM PAY WIDTH PER BEDDING MATERIAL & TRENCH EXCAVATION IS I.D. + 2'-0"
2. BEDDING AND BACKFILL MATERIAL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY.

TRENCH SECTION SANITARY SEWER LATERAL NTS

REVISIONS	
NO.	DATE
1	JUNE 2008
2	SEPT. 16, 2008