


GREATER NEW HAVEN WATER POLLUTION CONTROL AUTHORITY CONSTRUCTION DETAILS

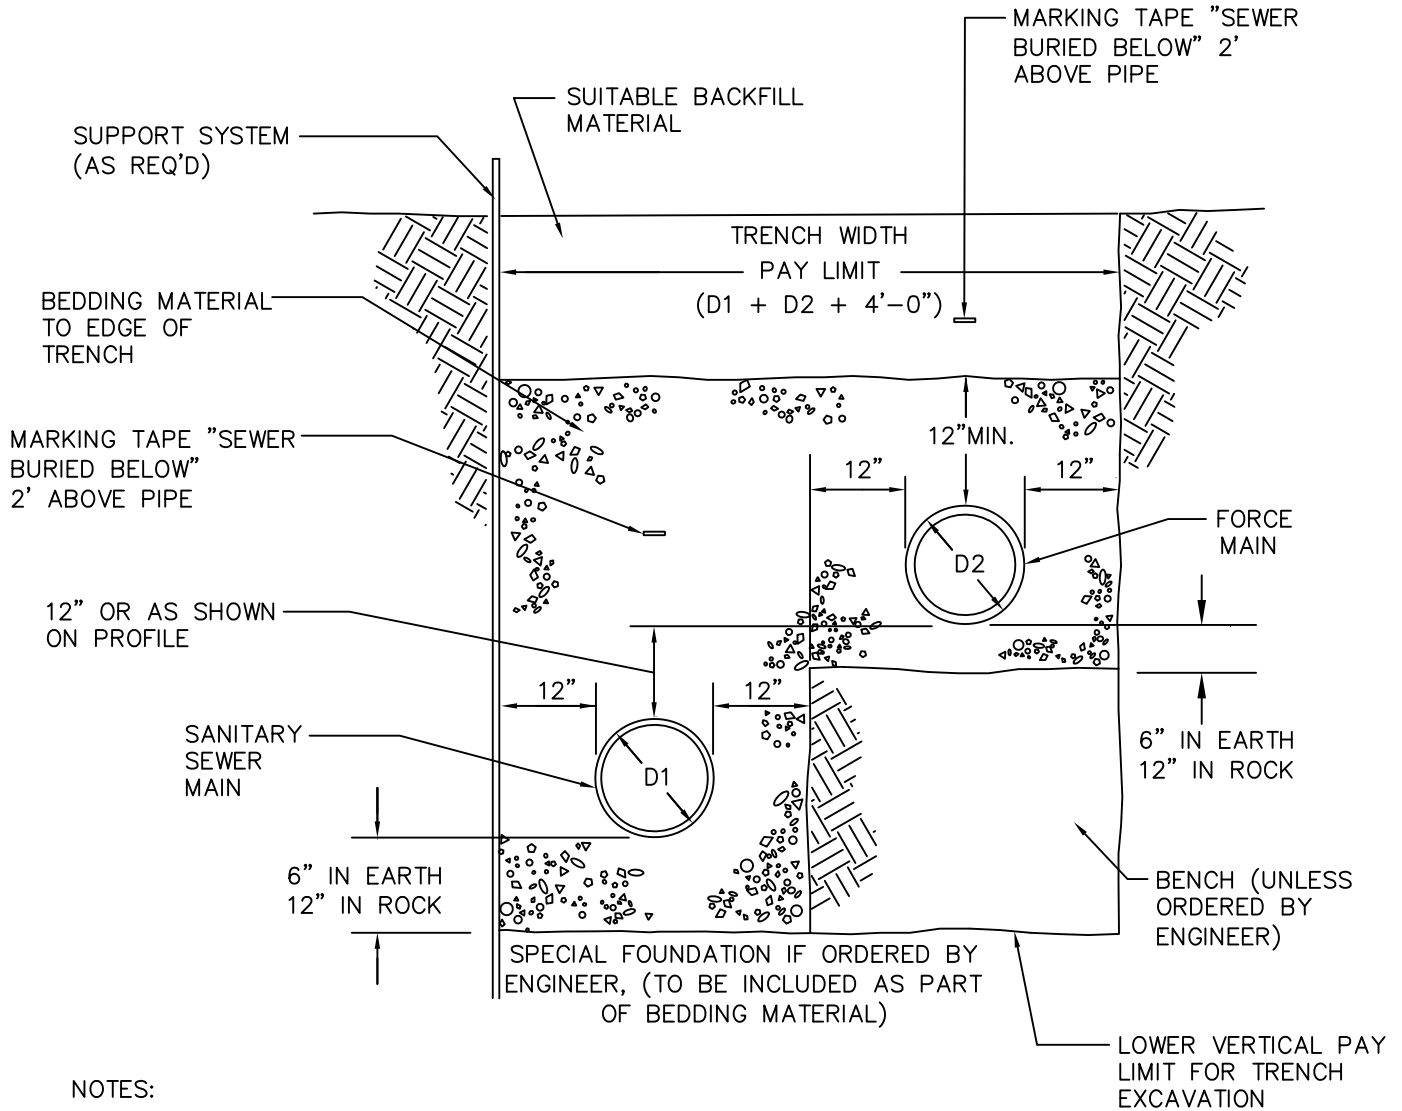

NOTES:

1. BEDDING AND BACKFILL MATERIAL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY.
2. BEDDING MATERIAL SHALL BE WRAPPED IN MIRAFI 140N FILTER FABRIC OR APPROVED EQUAL.

FORCE MAIN & SANITARY SEWER IN SAME TRENCH NTS

REVISIONS	
NO.	DATE
2	JANUARY, 2020