

GREATER NEW HAVEN WATER POLLUTION CONTROL AUTHORITY CONSTRUCTION DETAILS




REMOVE MANHOLE FRAME AND COVER AND RETURN TO 345 EAST SHORE PARKWAY NEW HAVEN, CT 06512

EXISTING FINISHED GRADE

REMOVE MANHOLE TO 1'-0" MINIMUM BELOW FINISH GRADE.

FILL MANHOLE SOLID WITH CONTROLLED LOW STRENGTH MATERIAL (CLSM).

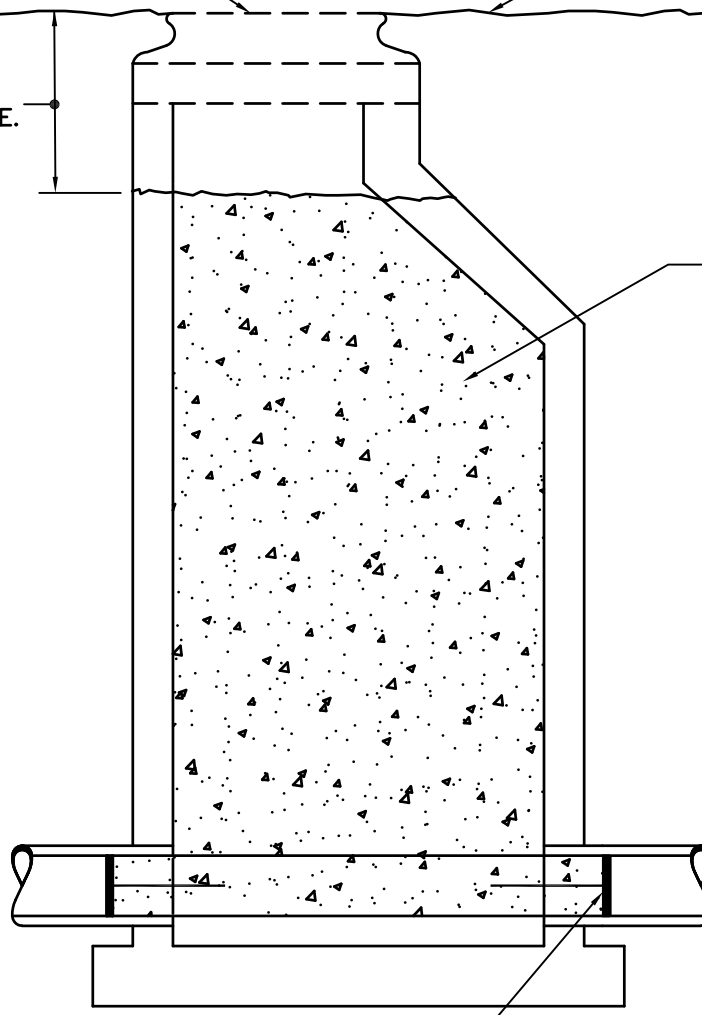

FOR SEWERS SMALLER THAN 18". SET MECHANICAL PLUGS INTO ALL PIPES ENTERING MANHOLES AS SHOWN. FOR SEWERS 18" AND LARGER DIAMETER PROVIDE MASONRY BULKHEAD IN LIEU OF MECHANICAL PLUGS.

PERMANENT MANHOLE ABANDONMENT NTS

REVISIONS	
NO.	DATE
2	JANUARY, 2020